

# STRUCTURAL NOTES

## GENERAL NOTES:

1. INTERPRETATION OF THE DRAWING INDICATED DIMENSIONS SHALL COVER AND DIMENSIONS AND SIZES NOT BE SOLID FOR CONSTRUCTION PURPOSES.
2. WALLS AND SLABS: INTERIOR FINISHES SHALL BE 1/2" THICK. EXTERIOR FINISHES SHALL BE 1/2" THICK. ALL WALLS AND SLABS SHALL BE CONCRETE UNLESS OTHERWISE NOTED.
3. ALL CONCRETE SHALL BE 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI UNLESS OTHERWISE NOTED.
4. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
5. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
6. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
7. SHOP DRAWINGS WITH SECTION AND TYPICAL DETAILS OF ALL STRUCTURAL STEELS, MECHANICAL ROOM, PRE-CAST CONCRETE, ETC. SHALL BE SUBMITTED FOR ENGINEER'S APPROVAL BEFORE PROCEEDING WITH CONSTRUCTION.
8. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
9. APPROVED BY THE ARCHITECTURAL, ELECTRICAL, AND MECHANICAL ENGINEERS.

## FOUNDATION

1. THE DESIGNER HAS ASSUMED SOIL BEARING CAPACITY OF 2000 PSF (20000 N/M<sup>2</sup>). CONTRACTOR SHALL VERIFY SOIL BEARING CAPACITY THROUGH SOIL TESTING AND CORRECT FOUNDATION DESIGN AS NECESSARY.
2. FOUNDATION SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
3. ALL FOUNDATION SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.

## CONCRETE

1. CONCRETE MINIMUM ULTIMATE COMPRESSIVE STRENGTH AT 28 DAYS SHALL BE:
  - f'c = 3070 MPa (440 ksi) FOR GENERAL FLOORING, BEAM BLOCKS, FOOT AND WALL FOOTING;
  - f'c = 27.6 MPa (4000 psi) FOR CONCRETE FOUNDATION WORKS;
  - f'c = 27.6 MPa (4000 psi) FOR GENERAL FLOORING, BEAMS, GIRDERS, AND BEAMS; SLAB ON GRADE;
  - f'c = 24.1 MPa (3500 psi) FOR SELECTED COLUMN;
  - f'c = 10.3 MPa (1500 psi) FOR ALL LEAN CONCRETE.
2. AGGREGATE SIZE SHALL BE THE FOLLOWING:
  - 20 MM MAX.
  - 25 MM MAX.
3. MINIMUM CONCRETE COVER FOR REINFORCING AS FOLLOWS:
  - 50 MM
  - 40 MM
  - 20 MM
  - 20 MM
  - 75 MM

4. ALL REINFORCING STEEL: BARS, HOOKS, BENTS AND OTHER DETAILS SHALL BE SECURED IN POSITION PRIOR TO POURING CONCRETE.
5. CONCRETE CHANGES SHALL BE TAKEN FOR EACH DAY FROM 400 TO 500 CUBIC METERS OR FRACTION THEREOF OR AS AGREED WITH ARCHITECT, CIVIL AND TESTED IN ACCORDANCE WITH ASTM C919.
6. CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
7. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
8. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
9. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
10. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.

## REINFORCING STEEL BARS


1. REINFORCING STEEL BARS SHALL BE PROVIDED UNLESS OTHERWISE NOTED TO ASTM A615 GRADE 60 (60,000 PSI) 14 MMS - #18 & HEAVIER.
2. ALL CONTIGUOUS REINFORCEMENTS SHALL BE SUBMITTED FOR REVIEW BY THE STRUCTURAL ENGINEER.
3. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
4. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
5. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
6. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
7. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
8. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
9. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
10. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.

## COLUMNS

1. REINFORCING STEEL BARS SHALL BE PROVIDED WITH TRANSVERSE REINFORCEMENT SPACED AT THREE TIMES THE DIAMETER OF THE BAR, BUT NOT GREATER THAN 150 MM (6 IN) OVER A DISTANCE OF 4800 MM (200 IN) FROM THE TOP AND BOTTOM OF THE COLUMN.
2. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
3. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
4. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
5. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.

## BEAMS AND GIRDERS

1. UNLESS OTHERWISE NOTED IN PLANS OR SPECIFICATIONS, CHAIRS, ALL BEAMS AND GIRDERS AT LEAST 800 MM (32 IN) HIGH SHALL BE PROVIDED WITH TRANSVERSE REINFORCEMENT SPACED AT THREE TIMES THE DIAMETER OF THE BAR, BUT NOT GREATER THAN 150 MM (6 IN) OVER A DISTANCE OF 4800 MM (200 IN) FROM THE TOP AND BOTTOM OF THE BEAM.
2. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
3. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.
4. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.



5. BEAM REINFORCING STEEL BARS, TOP AND BOTTOM, TERMINATING IN WALLS SHALL BE EXTEND AT THE MOST 500MM FROM THE FACE OF THE WALL AND SHALL BE TYPED WITH THE FOLLOWING:
  - 1 - #12M @ 500MM O.C.
  - 2 - #12M @ 500MM O.C.
6. LONGITUDINAL REINFORCEMENT OF GIRDERS, BOTH TOP AND BOTTOM, TERMINATING IN WALLS SHALL BE EXTEND TO THE FACE OF THE COMPRESSED CONCRETE CORE OF THE COLUMN AND TERMINATED BY A STANDARD 90 DEG. HOOK.
7. GENERALLY, NO LAP SPICES SHALL BE PRINTED ON BEAMS AND GIRDERS AT POINTS WHERE CRITICAL MOMENTS OR SHEAR OCCUR. TO AVOID LAP SPICES, THE MEMBER SHALL BE EXTENDED WITHIN THE JOINTS OR WITHIN A DISTANCE EQUAL TO THE MEMBER BEYOND FROM THE FACE OF THE COLUMN.
8. PROVIDE LAP SPICES IN GIRDERS WITH HOOP REINFORCEMENT OVER THE LENGTH OF THE LAPTED BARS SPACED NO GREATER THAN ONE-TWENTY (1/20) THE NORMAL TOP OR BOTTOM.
9. WELDED SPICES AND MECHANICAL CONNECTIONS WASTE USED FOR SPICING BEAMS AND GIRDERS PROVIDED THAT NO CENTER TO CENTER SPICES BETWEEN SPICES OF ADJACENT BARS IS TO EXCEED 1000MM (39 IN).
10. AT LOCATIONS OF REINFORCED SLABS, TOP OF BEAMS AND GIRDERS SHALL BE REINFORCED.

## CONCRETE SLABS

1. ALL SLAB REINFORCEMENT HAVE A MINIMUM CLEAR DISTANCE OF 20MM FROM THE BOTTOM AND FROM THE TOP OF SLABS.
2. IF SLABS ARE REINFORCED WITHIN BEAMS, THE REINFORCING STEEL SHALL BE PLACED BELOW THOSE BARS WHICH ARE LOCATED NEAR THE TOP OF THE BEAM. THE REINFORCING STEEL SHALL BE PLACED ABOVE THOSE BARS WHICH ARE LOCATED NEAR THE BOTTOM OF THE BEAM.
3. REINFORCING BARS FOR SLAB SHALL BE ORIGINALLY PLACED NEAR THE FACE IN REASON.

## REINFORCED CONCRETE WALLS

1. ALL WALLS SHALL BE REINFORCED ACCORDING TO THE FOLLOWING SCHEDULE OF WALL REINFORCEMENTS UNLESS OTHERWISE INDICATED IN THE PLANS.

THICKNESS	REINFORCEMENT	REMARKS
100	HORIZONTAL: #10MM @ 300 MM VERTICAL: #10MM @ 300 MM	VERT. BARS @ CENTERS. HOR. BARS STAGGERED
150	HORIZONTAL: #10MM @ 250 MM VERTICAL: #10MM @ 300 MM	VERT. BARS @ CENTERS. HOR. BARS STAGGERED
175	HORIZONTAL: #10MM @ 250 MM VERTICAL: #10MM @ 300 MM	VERT. BARS @ CENTERS. HOR. BARS STAGGERED
200	HORIZONTAL: #10MM @ 250 MM VERTICAL: #10MM @ 300 MM	VERT. BARS @ CENTERS. HOR. BARS STAGGERED
225	HORIZONTAL: #10MM @ 250 MM VERTICAL: #10MM @ 300 MM	VERT. BARS @ CENTERS. HOR. BARS STAGGERED
250	HORIZONTAL: #10MM @ 250 MM VERTICAL: #10MM @ 300 MM	VERT. BARS @ CENTERS. HOR. BARS STAGGERED

2. REINFORCING BARS SHALL HAVE A MINIMUM CLEAR CONCRETE COVER FROM FACE OF WALL EXCEPT FOR WALLS PERMANENTLY EXPOSED TO THE ENVIRONMENT. THE MINIMUM COVER SHALL BE 75MM (3 IN).
3. CHAIR VERTICAL BARS AT LEAST 50MM ABOVE FLOOR LEVEL TO PREVENT THIS SPACES FROM BEING OCCUPIED BY WASTE MATERIALS. CHAIRS SHALL BE STAYED BY LAPPING A REINFORCING EQUAL TO 40MM DIA. DIAMETERS AND VERTICAL SPACING WITH 10% OF THE HORIZONTAL SPACING. THE SPACING SHALL BE 100MM (4 IN) UNLESS OTHERWISE NOTED IN THE PLANS.
4. UNLESS OTHERWISE NOTED IN THE PLANS, ALL OPENINGS IN WALLS SHALL BE REINFORCED AROUND THE PERIMETER WITH #10MM DIA. BARS. ALL WALLS SPACING REINFORCEMENT SHALL BE 100MM (4 IN) UNLESS OTHERWISE NOTED.

## MASONRY BLOCK WALLS

1. ALL WALLS AND REINFORCEMENT SHALL BE IN ACCORDANCE WITH THE APPLICABLE STANDARDS AND SPECIFICATIONS OF THE NATIONAL CONCRETE MASONRY ASSOCIATION AND NATIONAL BUILDING CODE.
2. CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C 90 GRADE N, HIGH-COLD WEARING BLOCKS HAVE AN ABSORPTION OF 18% OR LESS.
3. MINIMUM 20% - DRY WEIGHT COMPRESSIVE STRENGTH SHALL BE USED FOR ALL REINFORCING (AS PER PLAN).
4. ALL CONCRETE, HOLLOW BLOCKS MASONRY WALLS SHALL BE SET IN REINFORCING (AS PER PLAN).
5. ALL WALLS SHALL BE FINISHED WITH PLASTER OR FINISHING COURSE.
6. UNLESS OTHERWISE NOTED ALL EXTERIOR WALL SHALL BE 4" CYB & INTERIOR WALL 4" SW.
7. ALL MASONRY UNITS SHALL BE REINFORCED ACCORDING TO THE FOLLOWING SCHEDULE UNLESS OTHERWISE NOTED IN THE PLANS.

BLOCK TYPE	REINFORCEMENT		NOTES
	HORIZONTAL	VERTICAL	
75 MM	#10MM @ 300MM	#10MM @ 300MM	A. VERTICAL LAP SPICES SHALL BE 400MM (16 IN) MINIMUM. B. HORIZONTAL BARS SHALL BE PLACED AT THE TOP OF THE WALL. C. ALL WALLS SHALL BE FINISHED WITH PLASTER OR FINISHING COURSE.
100 MM	#10MM @ 250MM	#10MM @ 300MM	
150 MM	#10MM @ 250MM	#10MM @ 300MM	
200 MM	#10MM @ 250MM	#10MM @ 300MM	

CLEAR HEIGHT (M)	TOTAL LENGTH (M)	HEIGHT OF LUTEL (M)		TOP BARS	LOCAL BARS	TIES
		#10MM	#12MM			
1.00	100.0	13.8	200	1 - #12M @ 510 @ 200 O.C.	1 - #12M @ 510 @ 200 O.C.	
1.50	150.0	13.8	200	1 - #12M @ 510 @ 200 O.C.	1 - #12M @ 510 @ 200 O.C.	
2.00	200.0	13.8	200	2 - #12M @ 510 @ 200 O.C.	2 - #12M @ 510 @ 200 O.C.	
2.50	250.0	13.8	200	2 - #12M @ 510 @ 200 O.C.	2 - #12M @ 510 @ 200 O.C.	
3.00	300.0	13.8	300	2 - #12M @ 510 @ 200 O.C.	2 - #12M @ 510 @ 200 O.C.	

## SLAB-ON-GRADE

1. THE SOIL SURFACE AND ALL LEVELS BELOW ALL SLABS ON GRADE SHALL BE FINISHED TO A MINIMUM OF 100MM (4 IN) BELOW THE FINISHED GRADE. ALL SLABS ON GRADE SHALL BE REINFORCED WITH #10MM BARS AT 200MM O.C. EXCEPT WHERE OTHERWISE NOTED. ALL SLABS ON GRADE SHALL BE REINFORCED WITH #10MM BARS AT 200MM O.C. EXCEPT WHERE OTHERWISE NOTED.
2. UNLESS OTHERWISE NOTED, ALL SLABS ON GRADE SHALL BE REINFORCED WITH #10MM BARS AT 200MM O.C. EXCEPT WHERE OTHERWISE NOTED.
3. ALL REINFORCING STEEL BARS SHALL BE PLACED IN ACCORDANCE WITH THE ACI 318S, BUILDING CODE REQUIREMENTS FOR CONSTRUCTION OF CONCRETE.

<b>ROMBLON STATE UNIVERSITY</b> OFFICE OF AUXILIARY, PLANT SERVICES AND POLLUTION CONTROL UNIT	PROJECT TITLE: <b>CONSTRUCTION OF 2 - STOREY ACADEMIC BUILDING FOR THE COLLEGE OF ENGINEERING AND TECHNOLOGY (CET)</b>	SHEET CONTENT: <b>AS SHOWN</b>	PREPARED BY: <b>CAD OPERATOR</b> Newell M. Antoni
	CHECKED BY: APPROVED BY: APPROVED BY: APPROVED BY:	DATE: 1-27-17 TIN: 446-312-742-000	JOB NO.:














S-1





# STRUCTURAL NOTES

- NOTES:**
1. PROVIDE THESE ADDITIONAL BARS FOR ALL EXPOSED PLUS BARS (NOT SHOWN) PARALLEL TO SIDE OF OPENING OR TO THE FINDER OF TRIMMED BARS AT OPENING.
  2. SEE ARCHITECTURAL & MECHANICAL PLANS FOR BAY OPENING LOCATION.
  3. CUT TRIMMER BARS WHERE OPENING IS TRIMMED BY SEAL.
  4. DEVELOP BARS 1-412 TOP & BOTTOM BARS IF  $H > 3000$  1-412 TOP & BOTTOM BARS IF  $H < 3000$  OR 0.10% (NO APPROXIMATE REINFORCEMENT RATIO).

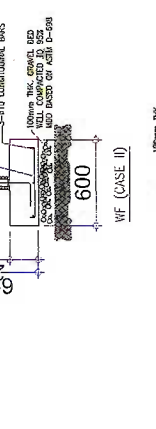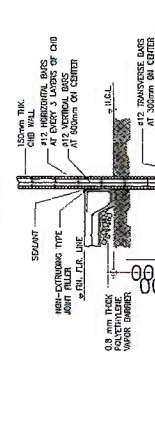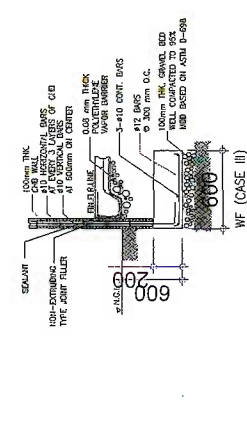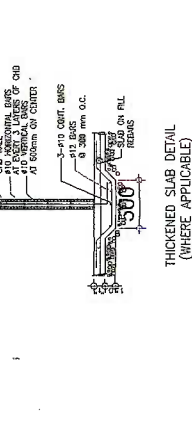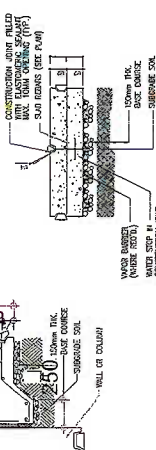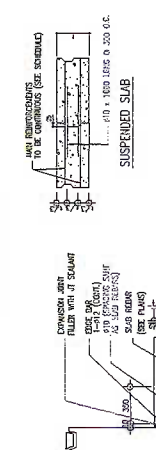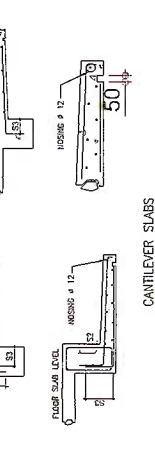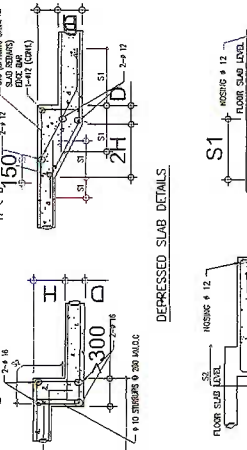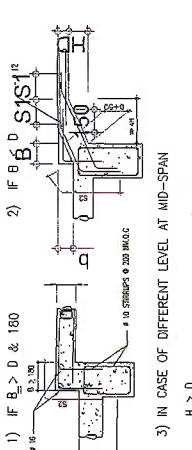

1. MISCELLANEOUS SLAB DETAILS

2. CHB CONNECTION DETAILS

3. CHB WALL FOOTING DETAILS (WHERE APPLICABLE)

<b>PREPARED BY:</b> ROMBLON STATE UNIVERSITY OFFICE OF AUXILIARY, PLANT SERVICES AND POLLUTION CONTROL UNIT	<b>CHECKED BY:</b> JERONIE ADOLFO F. FAJARITO ASST. DIRECTOR	<b>PROJECT TITLE:</b> CONSTRUCTION OF 2 - STOREY ACADEMIC BUILDING FOR THE COLLEGE OF ENGINEERING AND TECHNOLOGY (CET)	<b>SHEET CONTENT:</b> AS SHOWN	<b>PREPARED BY:</b> CAD OPERATOR: Menwe MC Abonon	S-3
	<b>APPROVED BY:</b> ISIDORO R. SALMINGO ASST. PROFESSOR	<b>LOCATION:</b> ROMBLON STATE UNIVERSITY - Main Campus, Limasac, Odongon, Romblon	<b>JOB NO.:</b>	<b>DATE:</b> JUNE 2017	
PTR No. : 1795904 Date : 1-27-17 Place: SAN JOSE, ROMBLON   TEL: 446-312-742-000	<b>PRC REG. NO.:</b> 46136922   Validity:	<b>DATE:</b>	<b>DATE:</b>		