



- LEGEND:
- ACU - AIRCONDITIONING UNITS
 - OU - OUTDOOR UNITS



I GROUND FLOOR ACU AND OUTDOOR UNIT PLAN

NTS.

PREPARED BY: ROMBLON STATE UNIVERSITY OFFICE OF PHYSICAL PLANT AND FACILITIES	MECHANICAL ENGINEER <i>[Signature]</i> PROJECT REG. NO.: 170625 / B. 171924 Validity: _____ URB: _____ TIN: _____	CHECKED BY: ANSON PABERON PROJECT MANAGER <i>[Signature]</i> APPROVED BY: MIRIAM P. SASTRANA-MANUEL D. CENSE RSM - Rombon	PROJECT TITLE: REHABILITATION AND FURNISHING OF OLD/EXISTING UNIVERSITY LIBRARY	SITE CONTEXT: LOCATION OF ACU AND OUTDOOR UNITS	PREPARED BY: CAD OPERATOR RSCG / SLM JOB NO.: _____ DATE: _____
<div style="border: 1px solid black; border-radius: 50%; width: 60px; height: 60px; display: flex; align-items: center; justify-content: center; margin: 0 auto;"> M-1 </div>					

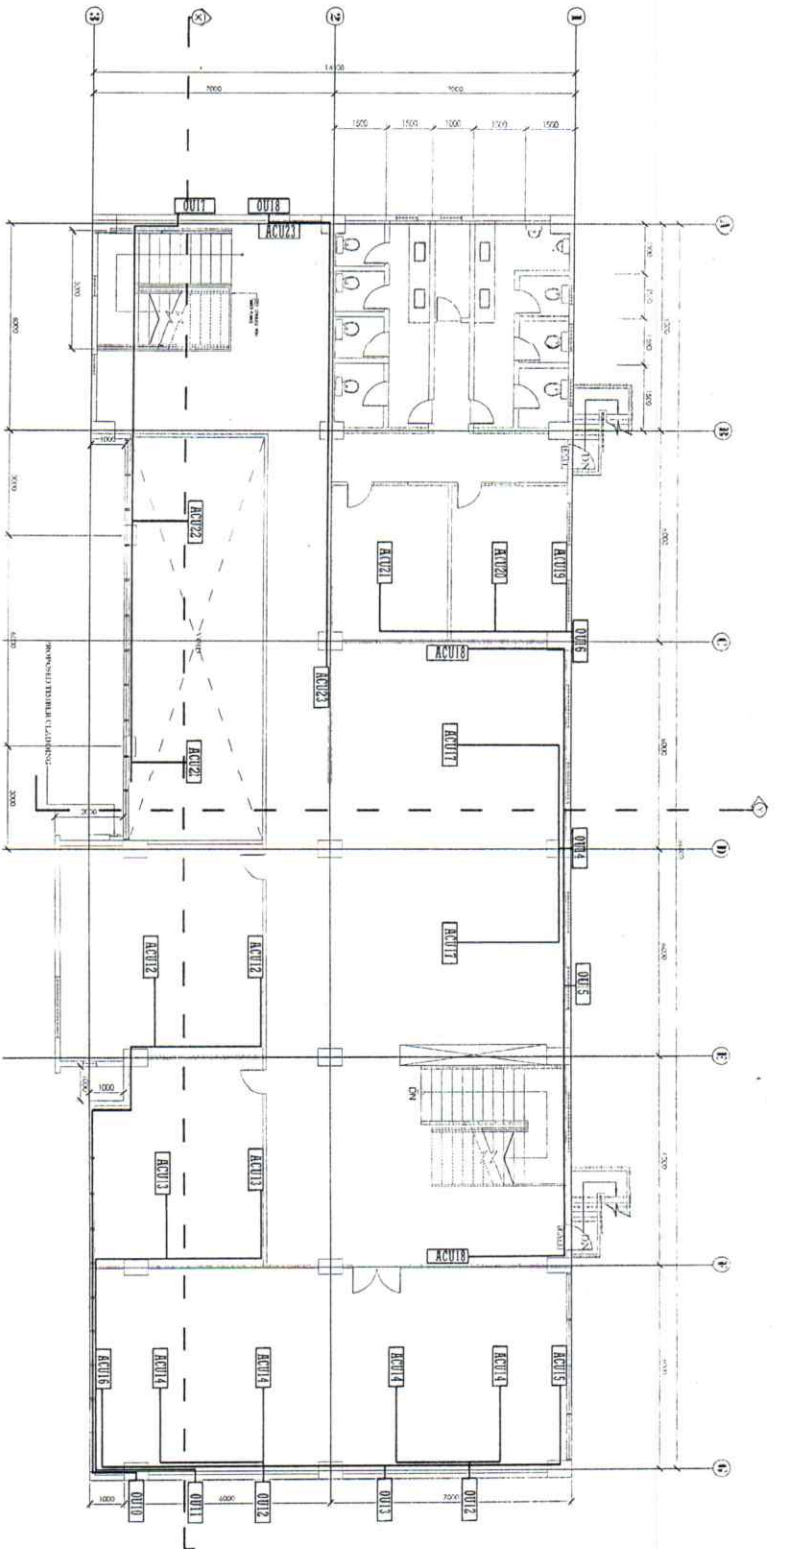

LEGEND:

ACU - AIRCONDITIONING UNITS


OU - OUTDOOR UNITS

1
M-2-M-2

1 SECOND FLOOR ACU AND OUTDOOR UNIT PLAN

NTS.


PREPARED BY: ROMBLON STATE UNIVERSITY OFFICE OF PHYSICAL PLANT AND FACILITIES	MECHANICAL ENGINEER <i>[Signature]</i>	CHECKED BY: <i>[Signature]</i>	PROJECT TITLE: REHABILITATION AND FURNISHING OF OLD/EXISTING UNIVERSITY LIBRARY	SHEET CONTENT: LOCATION OF ACU AND OUTDOOR UNITS	PREPARED BY: CAD OPERATOR: BSCC / SLM JOB NO. : DATE :
REC. REG. NO. : FIRM NO. : DATE : TIN :	VALIDITY : APPROVED BY: <i>[Signature]</i> MERAN P. CALAYAN, M.D., C.E.S.E. Res. Engineer	LOCATION : ROMBLON STATE UNIVERSITY - Main Campus, Limasag, Odongas, Romblon	M-2		

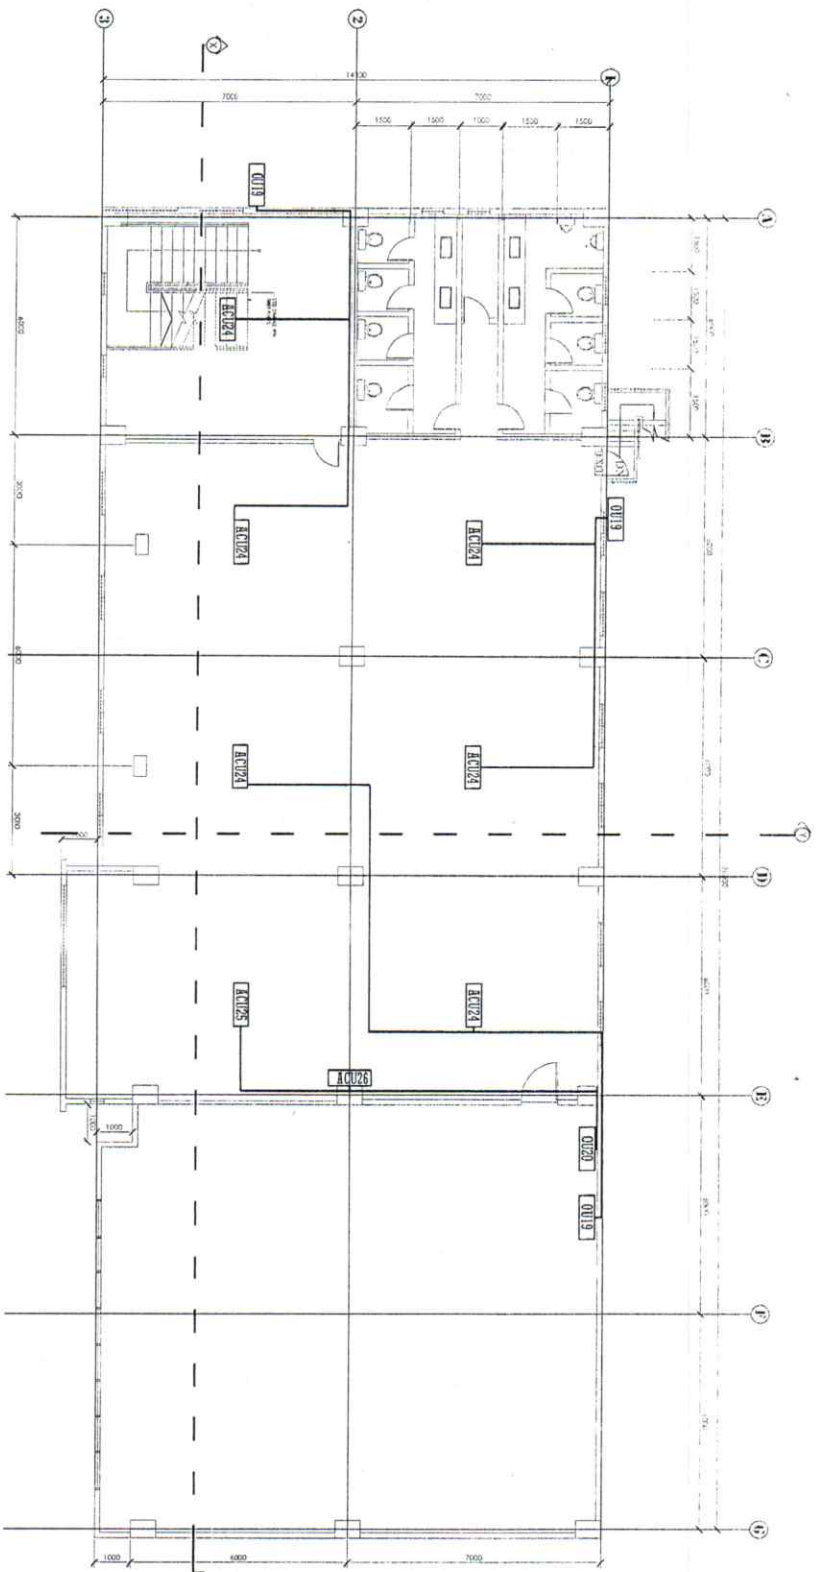

LEGEND:

ACU - AIRCONDITIONING UNITS

OU - OUTDOOR UNITS



1 THIRD FLOOR ACU AND OUTDOOR UNIT PLAN

NTS.

PREPARED BY: ROMBLON STATE UNIVERSITY OFFICE OF PHYSICAL PLANT AND FACILITIES	MECHANICAL ENGINEER <i>[Signature]</i> PRC REG. No. 106765 Validity: 12/18/2016 UABR: _____ TIN: _____	CHECKED BY: <i>[Signature]</i> JASON P. REJON PRC REG. No. _____ Validity: _____ UABR: _____ TIN: _____	PROJECT TITLE: REHABILITATION AND FURNISHING OF OLD/EXISTING UNIVERSITY LIBRARY	SHEET CONTENT: LOCATION OF ACU AND OUTDOOR UNITS	PREPARED BY: CAD OPERATOR: BCSG / SLM JOB NO.: _____ DATE: _____
LOCATION: ROMBLON STATE UNIVERSITY - Main Campus, Linaang, Olongapo, Romblon		APPROVED BY: <i>[Signature]</i> MERIANE CATANAN-AMANTE D. CISE PRC REG. No. _____ Validity: _____ UABR: _____ TIN: _____		<div style="border: 2px solid black; border-radius: 50%; width: 60px; height: 60px; display: flex; align-items: center; justify-content: center; margin: 0 auto;"> M-3 </div>	



AREA/ ROOM SERVED	INDOOR UNIT				OUTDOOR UNIT				
	LEGEND	HP (Refrigerant)	COOLING CAPACITY (BTU/Hr.)	TYPE	LEGEND	COOLING CAPACITY (BTU/Hr.)	HP (Refrigerant)	ELECTRICAL REQUIREMENT	TYPE
GROUP STAIR 1	AC011	1.50	12000	1 WALL MOUNTED	OU11	36000	4.00		
GROUP STAIR 2	AC012	1.50	12000	1 CEILING CASSETTE					
OPEN BOOK COLLECTION	AC014	2.50	24000	2 CEILING CASSETTE	OU12	48000	5.00		
LOBBY WAITING AREA	AC016	2.50	24000	2 WALL MOUNTED	OU13	48000	5.00		
STUDENT SERVICE AREA	AC018	2.00	18000	2 FLOOR MOUNTED	OU14	48000	4.00		220-240 VAC, 50Hz, 1Phase, 80Hz
STUDENT DINING	AC019	2.00	18000	2 CEILING CASSETTE	OU15	36000	4.00		
MAIN COLLECTION	AC0111	1.50	12000	4 CEILING CASSETTE	OU16	48000	5.00		
	AC0111	2.00	18000	2 WALL MOUNTED	OU17	36000	3.00		

ACU - AIR-CONDITIONING UNITS
OU - OUTDOOR UNITS

AREA/ ROOM SERVED	INDOOR UNIT				OUTDOOR UNIT				
	LEGEND	HP (Refrigerant)	COOLING CAPACITY (BTU/Hr.)	TYPE	LEGEND	COOLING CAPACITY (BTU/Hr.)	HP (Refrigerant)	ELECTRICAL REQUIREMENT	TYPE
CONFERENCE ROOM	AC012	2.00	18000	1 WALL MOUNTED	OU10	36000	4.00		
LIBRARY FACULTY OFFICE	AC013	1.50	12000	1 WALL MOUNTED	OU11	36000	3.00		
COMPUTER AND MEDIA CENTER	AC015	2.50	24000	4 CEILING CASSETTE	OU12	48000	5.00		
MAIN BOOK COLLECTION	AC016	1.50	12000	1 WALL MOUNTED	OU13	36000	4.00		220-240 VAC, 50Hz, 1Phase, 80Hz
STUDY ROOM 1	AC017	1.50	12000	2 CEILING CASSETTE	OU14	48000	5.00		
STUDY ROOM 2	AC019	1.50	12000	2 WALL MOUNTED	OU15	36000	3.00		
HALLWAY (OPEN SPACE TO STAIRS (DOOR AND SH))	AC022	2.50	24000	2 CEILING CASSETTE	OU17	48000	5.00		
	AC023	2.00	18000	2 WALL MOUNTED	OU18	36000	4.00		


ACU - AIR-CONDITIONING UNITS
OU - OUTDOOR UNITS

AREA/ ROOM SERVED	INDOOR UNIT				OUTDOOR UNIT				
	LEGEND	HP (Refrigerant)	COOLING CAPACITY (BTU/Hr.)	TYPE	LEGEND	COOLING CAPACITY (BTU/Hr.)	HP (Refrigerant)	ELECTRICAL REQUIREMENT	TYPE
MISCELLANEOUS	AC025	2.50	24000	1 WALL MOUNTED	OU20	48000	5.00		220-240 VAC, 50Hz, 1Phase, 80Hz

ACU - AIR-CONDITIONING UNITS
OU - OUTDOOR UNITS

1 AIRCONDITION/OUTDOOR UNIT DETAILS

R.T.S.

PREPARED BY: ROMBLON STATE UNIVERSITY OFFICE OF PHYSICAL PLANT AND FACILITIES	MECHANICAL ENGINEER <i>Wenceslao B. MORALES JR.</i> PROJECT NO.: DRAWING NO.: DATE:	CHECKED BY: <i>Jason E. REYON</i> PROJECT NO.: DRAWING NO.: DATE:	PROJECT TITLE: REHABILITATION AND FURNISHING OF OLD/EXISTING UNIVERSITY LIBRARY	SHEET CONTENT: AS SHOWN CAD OPERATOR: BCS / SLM JOB NO.: DATE:	
--	---	---	---	---	---